

Wavin Plastics Ltd

Parsonage Way
Chippenham
Wiltshire SN15 5PN
Tel: 01249 766600 Fax: 01249 443286
e-mail: info@wavin.co.uk
website: www.wavin.co.uk



Agrément Certificate
02/3940
Product Sheet 1

WAVIN TWINWALL DRAINAGE SYSTEM

WAVIN TWINWALL HIGH DENSITY POLYETHYLENE FILTER AND CARRIER PIPES (WITH INTERNAL PIPE DIAMETERS OF 150 mm, 225 mm AND 300 mm), RING SEALS AND COUPLINGS

PRODUCT SCOPE AND SUMMARY OF CERTIFICATE

This Certificate relates to Wavin TwinWall High Density Polyethylene Filter and Carrier Pipes (with Internal Pipe Diameters of 150 mm, 225 mm and 300 mm), Ring Seals and Couplings, for use in surface water drainage for the collection and disposal of surface and sub-surface water.

AGRÉMENT CERTIFICATION INCLUDES:

- factors relating to compliance with Building Regulations where applicable
- factors relating to additional non-regulatory information where applicable
- independently verified technical specification
- assessment criteria and technical investigations
- design considerations
- installation guidance
- regular surveillance of production
- formal three-yearly review.

KEY FACTORS ASSESSED

Strength — the product has adequate strength to resist loads associated with installation and subsequent use (see section 5).

Performance of the joints — the joints constructed from pipes and couplers with rubber seals remain watertight when subjected to deflection and distortion (see section 6).

Water infiltration — the slot area for the pipes exceeds the minimum relevant requirements (see section 7).

Flow characteristics — the pipes will have normal flow characteristics (see section 8).

Durability — the material from which the pipes and couplers are manufactured will not significantly deteriorate and the anticipated life of the system will be in excess of 50 years (see section 11).



The BBA has awarded this Agrément Certificate to the company named above for the system described herein. This system has been assessed by the BBA as being fit for its intended use provided it is installed, used and maintained as set out in this Certificate.

On behalf of the British Board of Agrément

Brian Chamberlain
Head of Approvals — Engineering

Greg Cooper
Chief Executive

Date of First issue: 19 October 2009

Originally certified on 10 July 2002

The BBA is a UKAS accredited certification body — Number 113. The schedule of the current scope of accreditation for product certification is available in pdf format via the UKAS link on the BBA website at www.bbacerts.co.uk

Readers are advised to check the validity and latest issue number of this Agrément Certificate by either referring to the BBA website or contacting the BBA direct.

British Board of Agrément
Bucknalls Lane
Garston, Watford
Herts WD25 9BA

©2009

tel: 01923 665300
fax: 01923 665301
e-mail: mail@bba.star.co.uk
website: www.bbacerts.co.uk

Regulations

In the opinion of the BBA, Wavin TwinWall High Density Polyethylene Filter and Carrier Pipes (with Internal Pipe Diameters of 150 mm, 225 mm and 300 mm), Ring Seals and Couplings, if used in accordance with the provisions of this Certificate, will meet or contribute to meeting the relevant requirements of the following Building Regulations:



The Building Regulations 2000 (as amended) (England and Wales)

Requirement:	H3(3)	Rainwater drainage
Comment:		The system will convey the flow of rainwater and minimise the risk of blockages or leakage. See sections 8.1 and 8.2 of this Certificate.
Requirement:	Regulation 7	Materials and workmanship
Comment:		The system is acceptable. See section 11 and the <i>Installation</i> part of this Certificate.



The Building (Scotland) Regulations 2004 (as amended)

Regulation:	8(1)(2)	Fitness and durability of materials and workmanship
Comment:		The system complies with this Regulation. See sections 10.1 to 10.4, 11 and the <i>Installation</i> part of this Certificate.
Regulation:	9	Building standards — construction
Standard:	3.6(a)	Surface water drainage
Comment:		The system will meet the relevant requirements of this Standard, with reference to clauses 3.6.1 ⁽¹⁾⁽²⁾ , 3.6.2 ⁽¹⁾⁽²⁾ and 3.6.3 ⁽¹⁾⁽²⁾ . See sections 8.1 and 8.2 of this Certificate. (1) Technical Handbook (Domestic). (2) Technical Handbook (Non-Domestic).



The Building Regulations (Northern Ireland) 2000 (as amended)

Regulation:	B2	Fitness of materials and workmanship
Comment:		The system is acceptable. See section 11 and the <i>Installation</i> part of this Certificate.
Regulation:	B3(2)	Suitability of certain materials
Comment:		The system is acceptable. See sections 10.1 to 10.4 of this Certificate.
Regulation:	N5	Rainwater drainage
Comment:		The system will meet the relevant requirements of this Regulation. See sections 8.1 and 8.2 of this Certificate.

Construction (Design and Management) Regulations 2007

Construction (Design and Management) Regulations (Northern Ireland) 2007

Information in this Certificate may assist the client, CDM co-ordinator, designer and contractors to address their obligations under these Regulations.

See section: 1 *Description* (1.3), 2 *Delivery and site handling* (2.1), 3 *General* of the *Design Considerations* part and 12 *General* of the *Installation* part.

Non-regulatory Information

NHBC Standards 2008

NHBC accepts the use of Wavin TwinWall High Density Polyethylene Filter and Carrier Pipes (with Internal Pipe Diameters of 150 mm, 225 mm and 300 mm), Ring Seals and Couplings, when installed and used in accordance with this Certificate, in relation to *NHBC Standards*, Chapter 5.3 *Drainage below ground*.

Zurich Building Guarantee Technical Manual 2007

In the opinion of the BBA, Wavin TwinWall High Density Polyethylene Filter and Carrier Pipes (with Internal Pipe Diameters of 150 mm, 225 mm and 300 mm), Ring Seals and Couplings, when installed and used in accordance with this Certificate, satisfy the requirements of the *Zurich Building Guarantee Technical Manual*, Section 3 *Substructure*, Sub-section *Drainage*.

General

This Certificate relates to Wavin TwinWall High Density Polyethylene Filter and Carrier Pipes (with Internal Pipe Diameters of 150 mm, 225 mm and 300 mm), Ring Seals and Couplings which are for use in highway drainage for the collection and disposal of surface and sub-surface water.

1 Description

1.1 Wavin TwinWall High Density Polyethylene Filter and Carrier Pipes (with Internal Pipe Diameters of 150 mm, 225 mm and 300 mm), Ring Seals and Couplings are manufactured in black polyethylene by a twin extrusion process. Two high-density polyethylene pipes are extruded simultaneously, one inside the other, and heat welded together in one continuous process.

1.2 The products tested and covered by this Certificate are manufactured from material with the specification given in Table 1.

1.3 The outer wall is corrugated and the inner wall is smooth finished. Details and dimensions are given in Table 2 and Figure 1.

1.4 Black polypropylene couplers are available for each size of pipe (see Table 3 and Figure 2).

1.5 Seals manufactured to BS EN 681-1 : 1996 (see Figure 3) must be fitted in accordance with the installation instructions to ensure a watertight joint.

1.6 Pipes can be supplied either slotted or unslotted. Slotted pipe (see Table 4 and Figure 4) is available with four slots in each dwell between corrugations equally spaced around the circumference. Alternatively the pipes are supplied with three slots per dwell to provide a solid invert (half perforated pipe) with the permeable area reduced proportionally.

1.7 Continuous quality control is exercised during manufacture. Checks include:

Pipes

- dimensional accuracy
- visual
- marking
- impact resistance
- weight

Couplers

- dimensional accuracy
- marking.

1.8 The BBA identification mark incorporating the number of this Certificate is printed on each pipe length or printed on a label for each pack of couplers.

Table 1 Material properties/specification⁽¹⁾

Property	Test method reference	Specification
Tensile properties	BS EN ISO 6259-1 : 2001, BS EN ISO 527-1 : 1996	Sample at 50 mm min ⁻¹ ≥ 20 MPa
Oxygen induction time	BS EN 728 : 1997	≥ 8 min
Melt flow rate	BS EN ISO 1133 : 2005	≤ 1.5 g (10 min) ⁻¹ 2.16 kg at 190°C
Density	ISO 1183-3 : 1999	≥ 850 kgm ⁻³
Heat reversion	ISO 12091 : 1995	110°C ± 2°C (pass)
Effects of heating (injection moulded fittings only)	BS EN ISO 580 : 2005	N/A

(1) This table is in the format of Appendix 5/7 of MCHW, Volume 2. It is used to satisfy Clause 5.18.2 of MCHW, Volume 1.

Table 2 Pipe dimensions

Nominal internal pipe diameter, d_1 (mm)	External pipe diameter, d_2 (mm)	t_1 (mm)	t_2 (mm)	t_3 (mm)	Nominal length (m)	Nominal weight (kgm ⁻¹)
150	177.3–180.3	1.0	2.2	1.0	6	1.50
225	267.0–270.0	1.0	2.8	1.3	6	3.75
300	353.0–356.0	1.3	2.8	1.5	6	6.00

Figure 1 Wavin TwinWall pipe

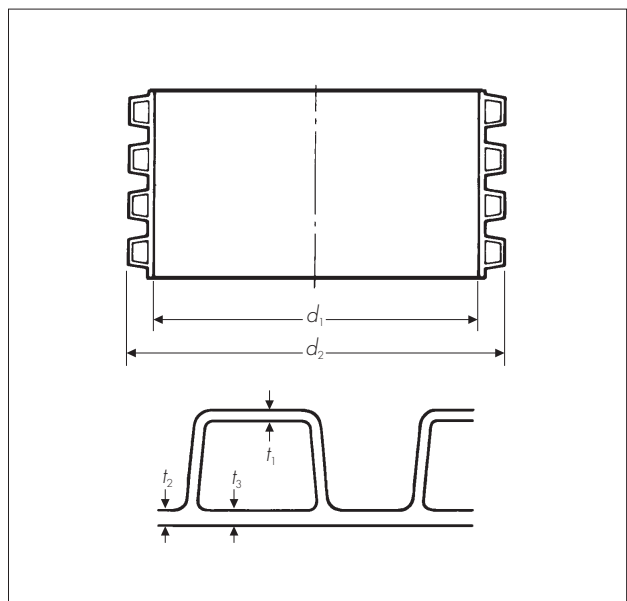


Table 3 Pipe coupler dimensions

Nominal pipe X (min) (mm)	Internal diameter d_3 (min) (mm)	Nominal external diameter d_4 (mm)	Nominal length (L) (mm)	Nominal seal height (h) (mm)
150	177.7	184.0	180	16
225	267.7	276.0	220	23
300	354.5	363.5	245	31

Table 4 Slotted pipe details

Nominal internal pipe diameter (mm)	No of slots per dwell	No of dwells per metre	Slot length (mm)	Slot width (mm)	Permeable area (min) (mm^2m^{-1})
150	4	51	15–20	2.0–2.5	6120
225	4	39	15–30	2.0–2.5	4680
300	4	32	20–40	2.0–2.5	5120

Figure 2 Pipe couplers

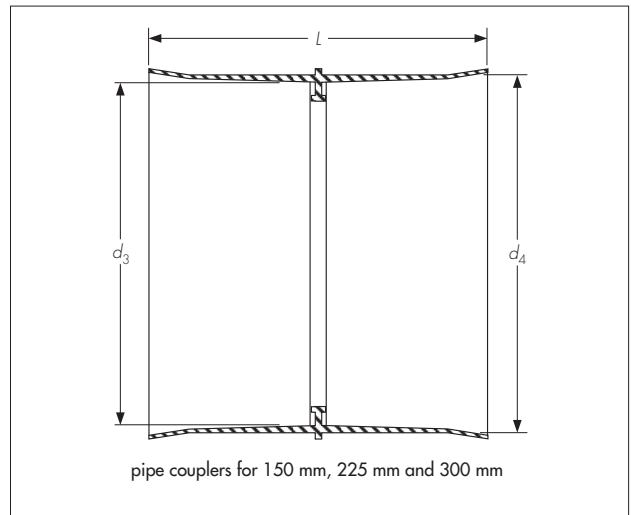


Figure 3 Seals


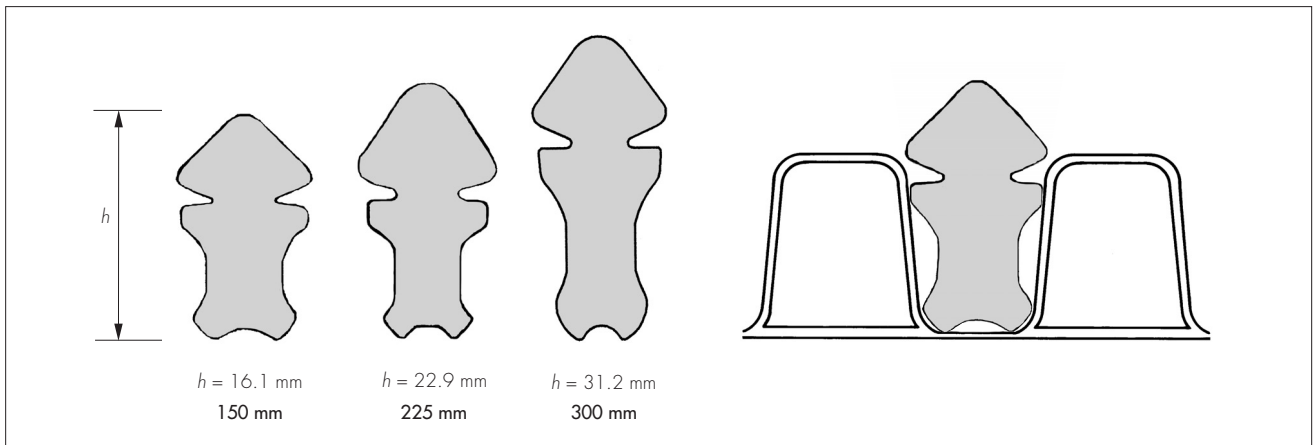


Figure 4 Details of slots

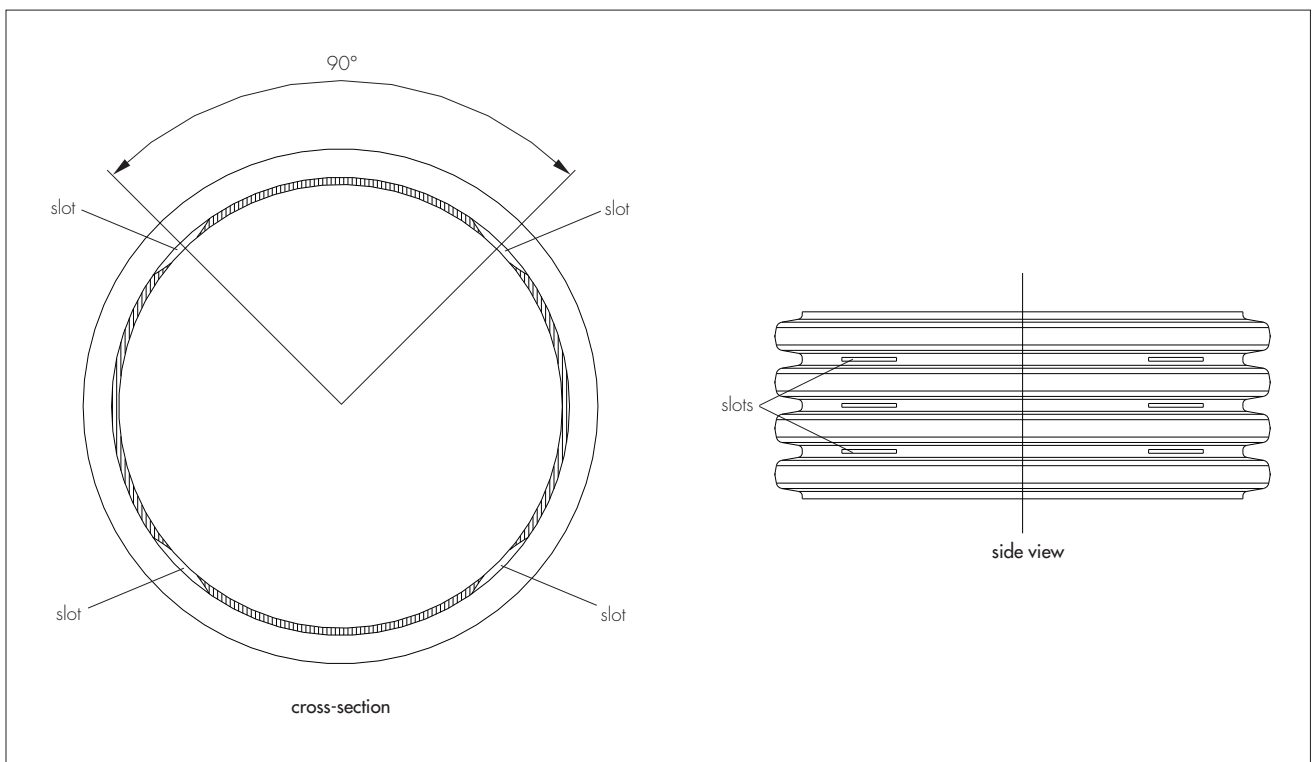

2 Delivery and site handling

2.1 Handling, storage and transportation should be in accordance with MCHW and manufacturer's instructions.

2.2 When long-term storage is envisaged, Wavin TwinWall slotted and unslotted filter and carrier pipes and couplings must be protected from direct sunlight. If protection cannot be provided, consideration must be given to the effects of daily exposure to direct sunlight:

- up to 3 months — negligible UV degradation but possible extreme surface temperatures of up to 80°C may cause some localised distortion
- 3 to 12 months — may have significant effect on the impact resistance and physical properties
- over 12 months — damage will occur unless protection provided.

2.3 Pipes should be suitably supported at a minimum of two places when being lifted. Protected slings should preferably be used, but if metal hooks or chains are used then padding should be placed between them and the pipes.

2.4 Pipes should be stored on a flat surface, free from sharp projections, stones or other protuberances. They are generally delivered in pre-packed bundles and should be retained in their packaging until installation. Care should be taken to avoid dropping the pipes on their ends, particularly during cold weather conditions.

Assessment and Technical Investigations

The following is a summary of the assessment and technical investigations carried out on Wavin TwinWall High Density Polyethylene Filter and Carrier Pipes (with Internal Pipe Diameters of 150 mm, 225 mm and 300 mm), Ring Seals and Couplings.

Design Considerations

3 General

Wavin TwinWall High Density Polyethylene Filter and Carrier Pipes (with Internal Pipe Diameters of 150 mm, 225 mm and 300 mm), Ring Seals and Couplings, comply with the requirements of the Highways Agency (HA) Manual of Contract Documents for Highway Works (MCHW)⁽¹⁾, Volume 1, Clause 518.5 for pipe, Clause 518.6 for couplers and Clause 518.7 for the system. When installed in accordance with the recommendations given in this Certificate, they are suitable for use in highways for the collection and disposal of surface and sub-surface water.

(1) The MCHW is operated by the Overseeing Organisations: The Highways Agency (HA), the Scottish Executive, the Welsh Assembly Government and The Department for Regional Development (Northern Ireland).

4 Practicability of installation

4.1 The product is designed to be installed by a competent contractor, experienced with this type of product.

4.2 The pipes are installed easily using traditional drain-laying methods in accordance with the HA requirements and Clauses 503, 505 and 518 of MCHW, Volume 1. The lengths in which the pipes are available and their lightness in weight are a significant advantage in handling and installation. Jointing of the pipes is achieved easily.

5 Strength

5.1 The product has adequate strength to resist loads associated with installation and with subsequent use. The ring stiffness of the pipe exceeds the minimum requirement of 6 kNm⁻² and has a creep ratio of less than 4.

5.2 For safe bedding-depth purposes the pipes can be considered to have a stiffness of greater than 6 kNm⁻².

5.3 The pipes have adequate resistance to impact loads to which they may have been subjected during installation and in service. Care should be taken during site handling and installation to avoid dropping the pipes on their ends, particularly during cold weather conditions.

6 Performance of joints

6.1 Joints on filter pipes made from pipe and couplers without the rubber seals are not partially watertight as defined in the MCHW, Volume 1, Clause 504.3.

6.2 Correctly made, the joints constructed from pipe and couplers with rubber seals remain watertight when subjected to deflection and distortion, and comply with the MCHW, Volume 1, Clauses 504.3 and 518.7 (see section 14).

7 Water infiltration

The slot area for the pipes exceeds the minimum requirement given in MCHW, Volume 1, Clause 518.3, of 1000 mm² per metre length.

8 Flow characteristics

8.1 The pipes will have normal flow characteristics associated with PVC-U pipes.



8.2 Full-bore velocity values are available from the *Table for the Hydraulic Design of Pipes, Sewers and Channels*, Volume 2, 8th Edition by H R Wallingford and D I H Barr. The values are based on the Colebrook-White equation. An appropriate value of roughness coefficient should be selected when designing the drainage system. For new pipes, a value of 0.006 mm is applicable, but for designs, a value of 0.6 mm is generally used.

9 Resistance to chemicals

The pipes will be unaffected by those types and quantities of chemicals likely to be found in surface water.

10 Maintenance



10.1 The slots are designed to restrict the ingress of silt into the drains.

10.2 Access to the system for cleaning should be provided by conventional methods.

10.3 The system can be rodded easily using flexible drain rods. In common with other standard plastic drainage systems, toothed root cutters and rods with metal ferrules, as used with some mechanical clearing systems, could damage the pipes and couplers and should not be used.

10.4 Tests indicate that the pipes have adequate resistance to water cleansing using pressure jetting equipment (see section 15.1). It is recommended that low-pressure, high-volume systems are utilised in accordance with MCHW, Volume 1, Clause 520.

11 Durability



In the opinion of the BBA, when used in the context of this Certificate, the material from which the pipes and couplers are manufactured will not significantly deteriorate and the anticipated life of the system will be in excess of 50 years.

Installation


12 General

Wavin TwinWall High Density Polyethylene Filter and Carrier Pipes (with Internal Pipe Diameters of 150 mm, 225 mm and 300 mm), Ring Seals and Couplings must be installed in accordance with the HA requirements and Clauses 503, 505 and 518 of MCHW, Volume 1.

13 Procedures

13.1 For typical laying, trench and backfilling specification details reference should be made to Figure 5 and the MCHW, Volume 3, Drawing No F1 (Types T and S) and F2 (Types G, H and I).

Figure 5 Installation details

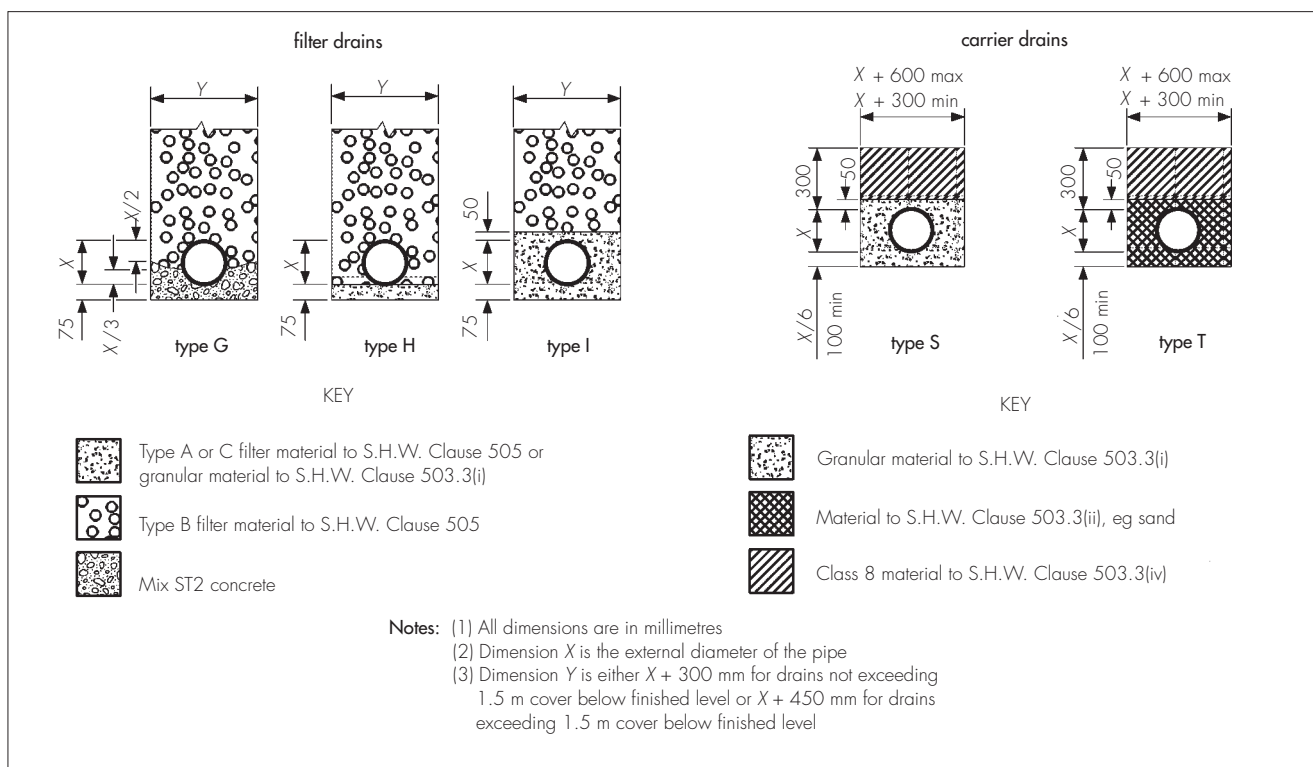

13.2 Pipes are cut easily using conventional hand tools, and should be cut square between the corrugations.

13.3 For a watertight joint, the pipe ends and coupler should be cleaned and a rubber seal fitted externally between the first and second corrugation in the pipe. The inside of the coupler should be lubricated and the pipe pushed fully home to the central register either by hand, or using a lever if necessary.

13.4 The slotted and unslotted pipes and couplings must be protected against damage from site construction traffic.

13.5 Care should be taken during backfill to maintain the line and level of the pipeline. If necessary, the pipe should be restrained to prevent uplift.

Technical Investigations

14 Tests

14.1 Tests were carried out on the pipe to determine compliance with MCHW, Volume 1, Clause 518.5, on:

- determination of ring stiffness to BS EN ISO 9969 : 1995
- creep ratio to BS EN ISO 9967 : 1995
- resistance to longitudinal bending to MCHW, Volume 1, Clause 518.11
- impact strength at 0°C and 23°C to BS EN 1411 : 1996 with a d25 striker of 1.0 kg mass
- rodding resistance to MCHW, Volume 1, Clause 518.12
- water jetting WRc method.

14.2 Tests were carried out on joined pipe to establish compliance with MCHW, Volume 1, Clause 518.7, on:

- leaktightness of joints to BS EN 1277 : 1996 when subjected to diameter distortion and angular deflection from 0.5 bar to -0.3 bar
- insertion force (ease of jointing)
- resistance to rodding.

14.3 Tests were carried out to establish the dimensional accuracy of the pipe, coupler and ring seal to ISO 11922-1 : 1997.

15 Investigations

15.1 An examination was made of data in relation to the affect of the production tolerances on the performance of the products.

15.2 An evaluation of existing data was made to assess material properties, chemical resistance and durability.

15.3 Calculations were carried out to determine the slot area.

15.4 The manufacturing process was examined, including the methods adopted for quality control, and details were obtained of the quality and composition of the materials used.

Bibliography

BS EN 681-1 : 1996 *Elastomeric seals — Material requirements for pipe joint seals used in water and drainage applications — Vulcanized rubber*

BS EN 1277 : 1996 *Methods of testing plastics — Thermoplastics pipes, fittings and valves — Plastics piping systems — Thermoplastics piping systems for buried non-pressure applications — Test methods for leaktightness of elastomeric sealing ring type joints*

BS EN 1411 : 1996 *Plastics piping and ducting systems — Thermoplastics pipes — Determination of resistance to external blows by the staircase method*

BS EN ISO 9967 : 1995 *Thermoplastics pipes — Determination of creep ratio*

BS EN ISO 9969 : 1995 *Thermoplastics pipes — Determination of ring stiffness*

BS EN 728 : 1997 *Plastics piping and ducting systems — Polyolefin pipes and fittings — Determination of oxidation induction time*

BS EN ISO 527-1 : 1996 *Methods of testing plastics — Mechanical properties — Determination of tensile properties — General principles*

BS EN ISO 580 : 2005 *Plastics piping and ducting systems — Injection-moulded thermoplastics fittings — Methods for visually assessing the effects of heating*

BS EN ISO 1133 : 2005 *Plastics — Determination of the melt mass-flow rate (MFR) and the melt volume-flow rate (MVR) of thermoplastics*

BS EN ISO 6259-1 : 2001 *Thermoplastics pipes — Determination of tensile properties — General test method*

ISO 1183-3 : 1999 *Plastics — Methods for determining the density of non-cellular plastics — Gas pycnometer method*

Conditions of Certification

16 Conditions

16.1 This Certificate:

- relates only to the product/system that is named and described on the front page
- is granted only to the company, firm or person named on the front page — no other company, firm or person may hold or claim any entitlement to this Certificate
- is valid only within the UK
- has to be read, considered and used as a whole document — it may be misleading and will be incomplete to be selective
- is copyright of the BBA
- is subject to English law.

16.2 Publications and documents referred to in this Certificate are those that the BBA deems to be relevant at the date of issue or re-issue of this Certificate and include any: Act of Parliament; Statutory Instrument; Directive; Regulation; British, European or International Standard; Code of Practice; manufacturers' instructions; or any other publication or document similar or related to the aforementioned.

16.3 This Certificate will remain valid for an unlimited period provided that the product/system and the manufacture and/or fabrication including all related and relevant processes thereof:

- are maintained at or above the levels which have been assessed and found to be satisfactory by the BBA
- continue to be checked as and when deemed appropriate by the BBA under arrangements that it will determine
- are reviewed by the BBA as and when it considers appropriate.

16.4 In granting this Certificate, the BBA is not responsible for:

- the presence or absence of any patent, intellectual property or similar rights subsisting in the product/system or any other product/system
- the right of the Certificate holder to manufacture, supply, install, maintain or market the product/system
- individual installations of the product/system, including the nature, design, methods and workmanship of or related to the installation
- the actual works in which the product/system is installed, used and maintained, including the nature, design, methods and workmanship of such works.

16.5 Any information relating to the manufacture, supply, installation, use and maintenance of this product/system which is contained or referred to in this Certificate is the minimum required to be met when the product/system is manufactured, supplied, installed, used and maintained. It does not purport in any way to restate the requirements of the Health & Safety at Work etc Act 1974, or of any other statutory, common law or other duty which may exist at the date of this Certificate; nor is conformity with such information to be taken as satisfying the requirements of the 1974 Act or of any statutory, common law or other duty of care. In granting this Certificate, the BBA does not accept responsibility to any person or body for any loss or damage, including personal injury, arising as a direct or indirect result of the manufacture, supply, installation, use and maintenance of this product/system.